

Emergency Generator Permitting Guidance

These permits are in addition to any RCID permits.

Air Emission Permitting: Timeline: up to 6 months

All new or replacement emergency generators, fire pumps and/or other stationary engines that use or burn fuel must be included in our property wide air permit, referred to as a Title V Permit. Additionally, regulations may require an Air Construction Permit be obtained prior to installation. If a construction permit is required, construction cannot commence until the permit has been received. Therefore, Environmental Affairs must be contacted during the planning or design phase and prior to ordering to determine if the equipment is approved by the EPA and if an air construction permit is required. The following information must be submitted to Environmental Affairs:

- Equipment Specification/Cut Sheets
- EPA Certificate of Conformity
- Emissions Data Sheet and Fuel Type
- Expected/actual installation and startup date
- O&M manual for the engine (not just the generator)
- Information on equipment that is being moved or replaced (if applicable)

Environmental Affairs will obtain all permits/approvals as well as submit the air construction permit application to the Florida Department of Environmental Protection (FDEP). The application must be approved by the FDEP and EPA. After FDEP/EPA approval, we must advertise the proposed installation in the Orlando Sentinel to allow the general public to comment before the construction permit is issued. This permitting process can take up to 6 months.

Fuel Storage Tank Permitting: Timeline: up to 2 months prior to placing the generator/tank on the concrete pad (permanent location).


All fuel storage tanks greater than 550 gallons (stand alone or part of a generator set) must be registered with the FDEP and inspected during installation. The following must be conducted prior to setting the tank on its permanent location:

- All tank and system components must be on the FDEP's Approved Equipment List.
- Orange County Environmental Protection Division (OCEPD), acting as agents for the FDEP, must be notified 30 to 45 days before installation or upgrading of a storage tank. Installation is defined as setting the generator/tank on the pad.
- OCEPD must be notified again 48 to 72 hours prior to installation.
- The tank and spill buckets must be pressure tested prior to filling.
- The tank must be registered with the FDEP and added to WDW's insurance policy prior to filling.


Environmental Affairs will register the tank with the FDEP and make the required notifications to OCEPD. This permitting process can take up to 2 months.

Note: Air emission and fuel storage tank permitting apply only to permanent/stationary; equipment used for or during construction do not require permitting.

If you have any questions or need additional information, please contact Jose Garrido at jose.r.garrido@disney.com. You can also call the Environmental Control Hotline at (407) 390-5242.

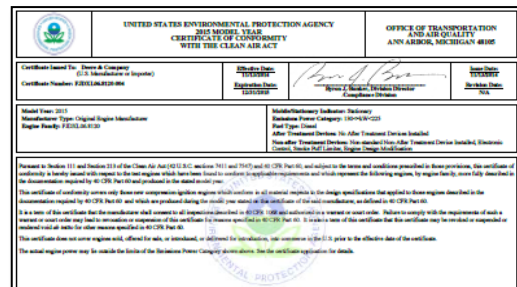

EPA Certificate of Conformity Example

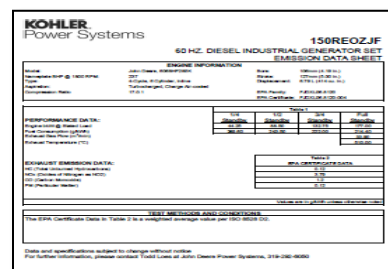

Emissions Data Sheet Example

